

UNDERGROUND PRIMARY SERVICE




NOTES:

- Due to supply chain constraints, there is a nationwide shortage of underground transformers available. For the current time, HCEC will install underground primary as follows:

Underground service to one (1) HCEC service pole including an overhead transformer with underground service to a meter pedestal. The HCEC member will be responsible for underground service leaving the meter base and making connections to the home.

- The Transformer Pole cannot be more than 100' from the meter pedestal.

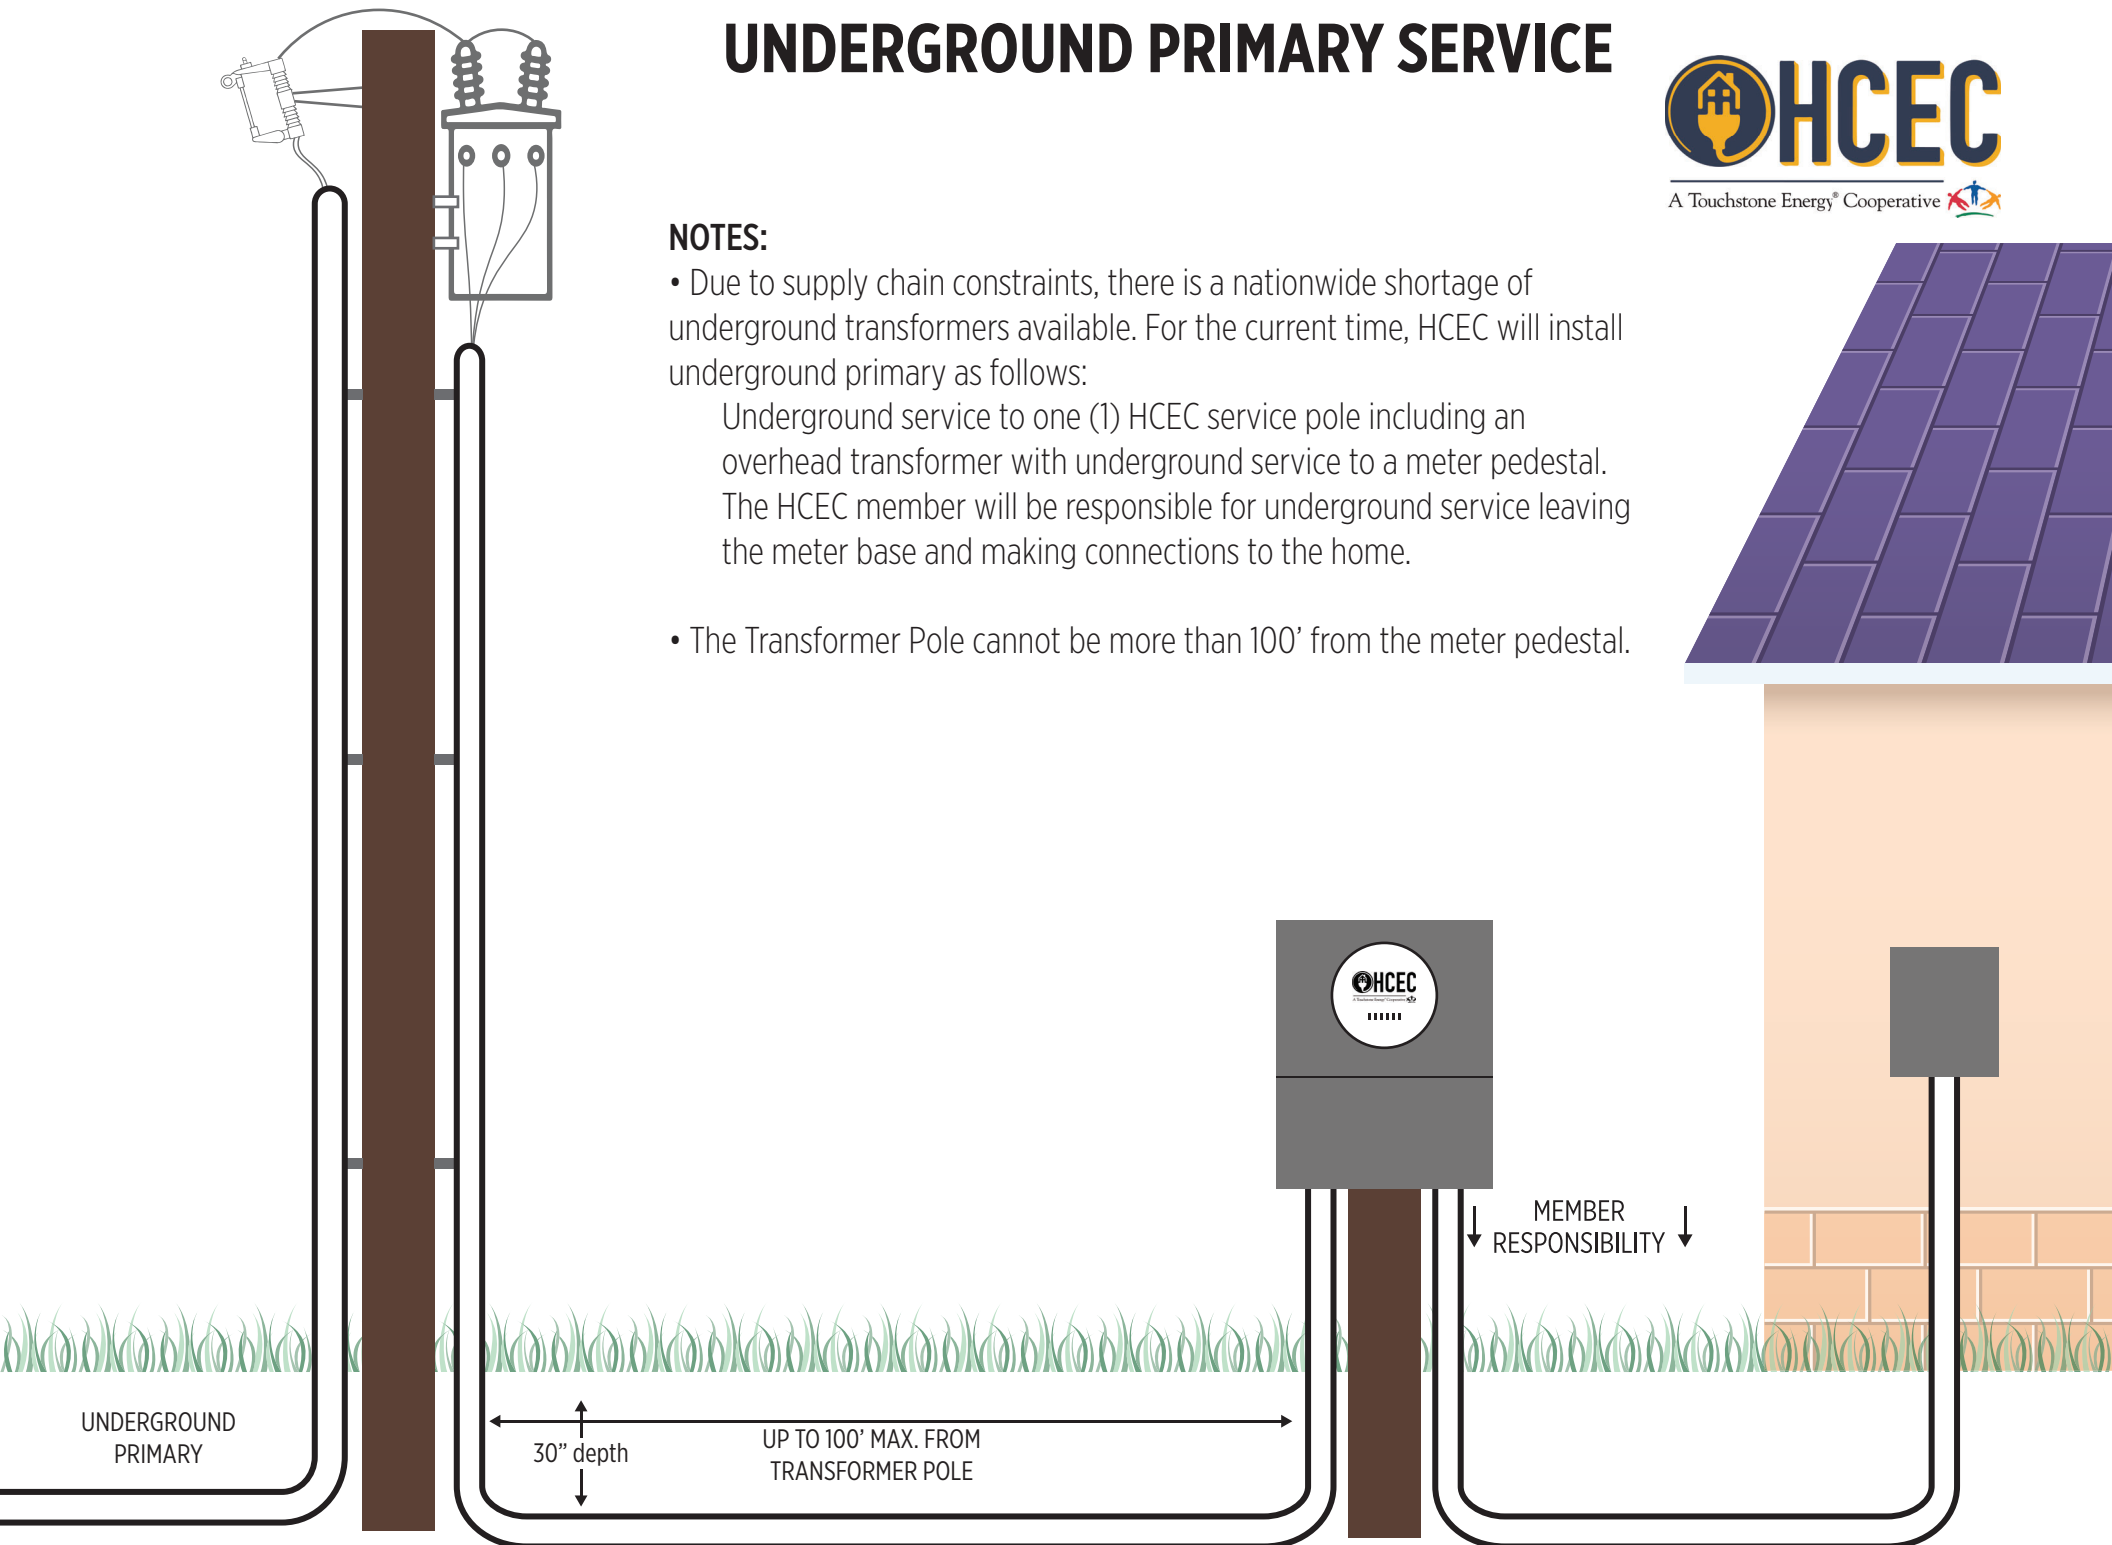

UNDERGROUND
PRIMARY

30" depth

UP TO 100' MAX. FROM
TRANSFORMER POLE

MEMBER
RESPONSIBILITY