




Your Touchstone Energy<sup>®</sup>  
Cooperative 

936-544-5641

**200 AMP**

**Underground (UG) Specifications on Pole Conduit to Meter on House**

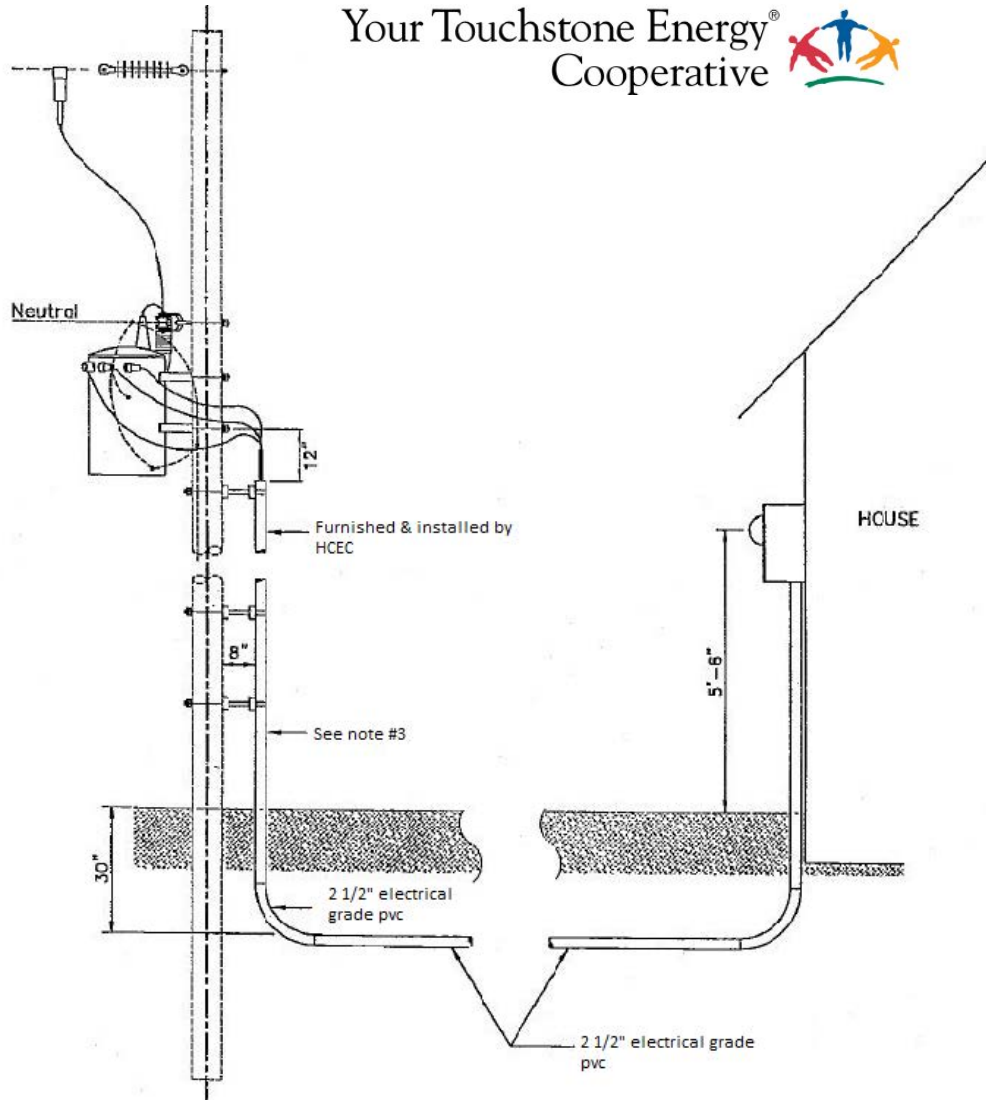

**NOTES:**

1. Member will be responsible for digging ditch and installing wire in conduit with elbow. Minimum depth of 30".
2. Co-op will furnish wire from house to transformer and underground meter base.
3. Member to install up to 18" above ground level with threaded nipple.

HCEC will furnish: A maximum of 250' of UG service wire from transformer to meter base, UG meter base, & 2 1/2" conduit up the transformer pole

- Customer to call when UG meter base is set and trench dug with pipe in ground and we will send a serviceman to measure length of UG service wire. \*\*\* Leave PVC elbow exposed for servicemen to inspect.
- Our warehouse will cut the UG wire and have it available in the warehouse from 7:30 AM until 3:00 PM Mon – Fri (Customer needs to verify wire is available before traveling to warehouse)
- Customer to pick up UG wire and install through conduit up to base of transformer pole.
- Once all connections have been made in customer's meter base and breaker box/outlets trimmed out, call 936-544- 5641 so that the serviceman can install up the transformer pole and install the electric meter.